

6

JOIST HANGER OR CLIP - SEE STRUCT. 2X LEDGER BOARD - SEE STRUCT DWGS (FIRE TREATED IF ALONG EAST FACADE - SEE LIFE SAFETY DRAWINGS)

-METAL HEAD TRIM

7/8" CORRUGATED METAL -

5/8" FIBERGLASS MAT GYPSUM SHEATHING AT 1 HR EXT. WALLS. -- 1/2" CDX/OSB AT NON-RATED WALLS - SEE LIFE SAFETY

4A A504 SECTION DETAIL - AT PARAPET WALL 3" = 1'-0"

3A
A504SECTION DETAIL - AT SOFFIT AND ALCOVE3" = 1'-0"

2X FASCIA BOARD (FIRE

3/4" OSB/CDX (FIRE TREATED IF SAFETY DRAWINGS) 2X8 FRAMING - 24" O.C. (FIRE

TREATED IF ALONG EAST FACADE - SEE LIFE SAFETY

DRAWINGS)

METAL HEAD TRIM - WEEPS 8" O.C. -METAL DRIP FLASHING -CLASS A ASPHALT SHINGLES JOIST HANGER OR CLIP - SEE STRUCT.

7/8" CORRUGATED METAL -EXPOSED FASTENERS -DRAINAGE WRAP - ASTM 2273

(2) 10D NAILS AT EACH DIAGONAL TRUSS MEMBER TREATED IF ALONG EAST FACADE - SEE LIFE SAFETY DRAWINGS)

TRUSS

2X8 FRAMING - 24" O.C. (FIRE

2X4 BLOCKING BETWEEN EACH

PREFABRICATED ROOF TRUSSES -

SLOPE TOP CHORD (2%)

2X4 BLOCKING BETWEEN EACH TRUSS

TRUSS

(4) 10D NAILS AT EACH VERTICAL TRUSS MEMBER 2X10 BLOCKING B/T EVERY

SEAMS

METAL COPING - MATCH SS ROOFING SEE TYP. TOP PLATE DETAIL 10/S2.1 FOR FASTENER (2) 2X TOP PLATE STAGGER

PREFABRICATED ROOF TRUSSES -

SHEATHING - SEE STRUCT. DWGS

SLOPE TOP CHORD (2%)

3/4" OSB/CDX FLOOR

TRUSS

INSULATION

STUD INTO TRUSS CHORD)

(2) 10D NAILS ON EA SIDE

TRUSS TO TOP PLATE)

SLOPE TOP CHORD (2%)

(2) 2X TOP PLATE STAGGER

H2.5A CLIP AT EACH TRUSS AND

2X WOOD STUDS BEYOND - SEE

SEAMS

STUD

STRUCT. DWGS

2X10 BLOCKING B/T EVERY 1/2" CDX/OSB WALL SHEATHING-TPO MEMBRANE RIGID INSULATION - 1" MIN. (3) O.131X3" NAILS (PARAPET STUD INTO TRUSS CHORD) 3/4" OSB/CDX FLOOR SHEATHING - SEE STRUCT. DWGS FILL ENTIRE CAVITY WITH BATT

(3) O.131X3" NAILS (PARAPET PREFABRICATED ROOF TRUSSES -SLOPE TOP CHORD (2%) -(TOENAIL BOTTOM CHORD OF PREFABRICATED ROOF TRUSSES -

FILL ENTIRE CAVITY WITH BATT INSULATION

5/8" GYP. BD. (PAINTED) AT CEILING

PREFABRICATED ROOF TRUSSES -SLOPE TOP CHORD (2%)

3





TREATED IF ALONG EAST FACADE - SEE LIFE SAFETY DRAWINGS) (6) 10D NAILS TO CONNECT

5/8" FIBERGLASS MAT GYPSUM WALLS - SEE LIFE SAFETY

SHEATHING AT 1 HR EXT. WALLS. -- 1/2" CDX/OSB AT NON-RATED


----FIBER CEMENT SOFFIT PANEL

EXPOSED FASTENERS


DRAWINGS FOR LOCATIONS

DRAWINGS FOR LOCATIONS

MIN (2) 10D NAILS INTO EACH RAFTER AND EACH EAVE JOIST

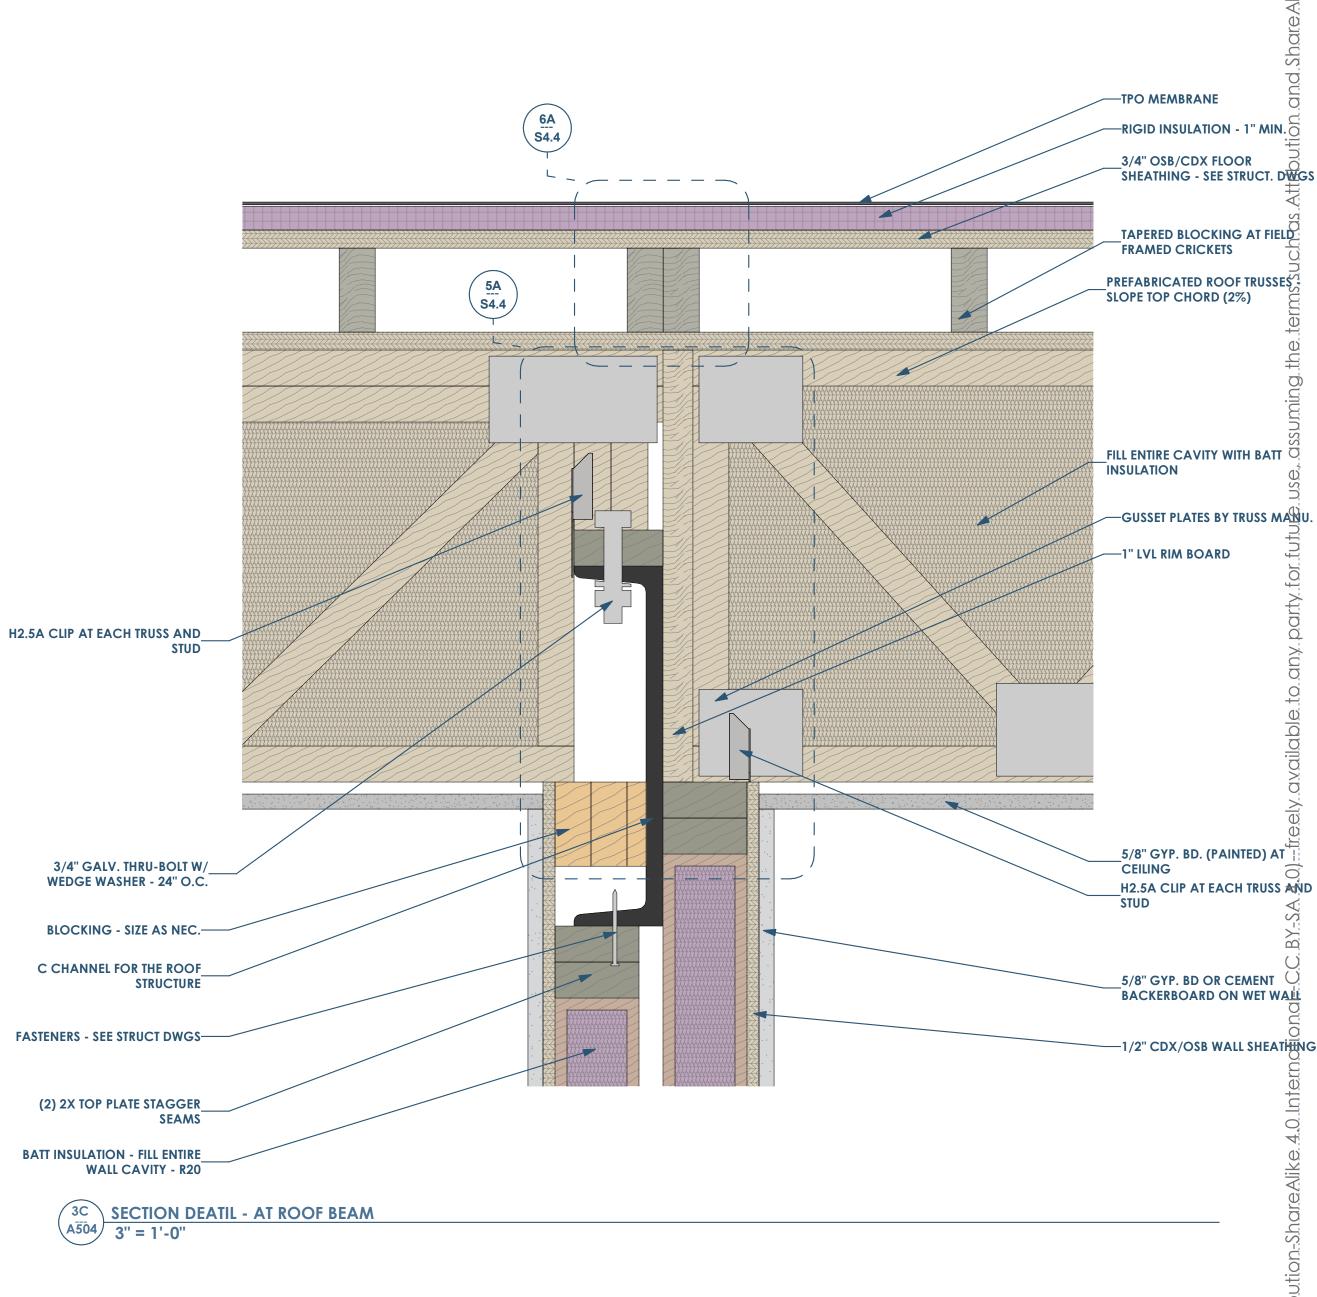

 \mathbf{O}

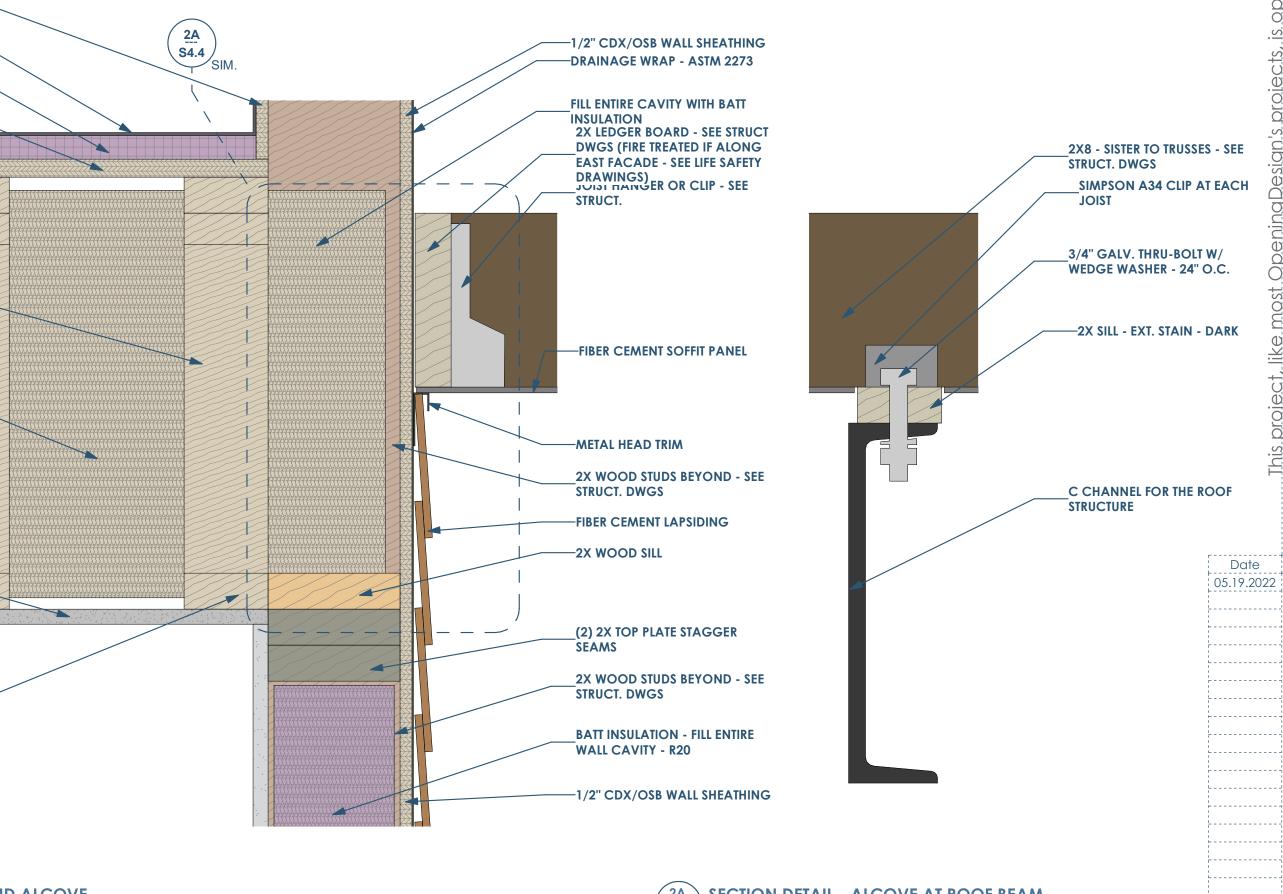

A504 SECTION DETAIL - ALCOVE AT ROOF BEAM 3" = 1'-0"

2

